


# City of North Pole Well Water Results 2010

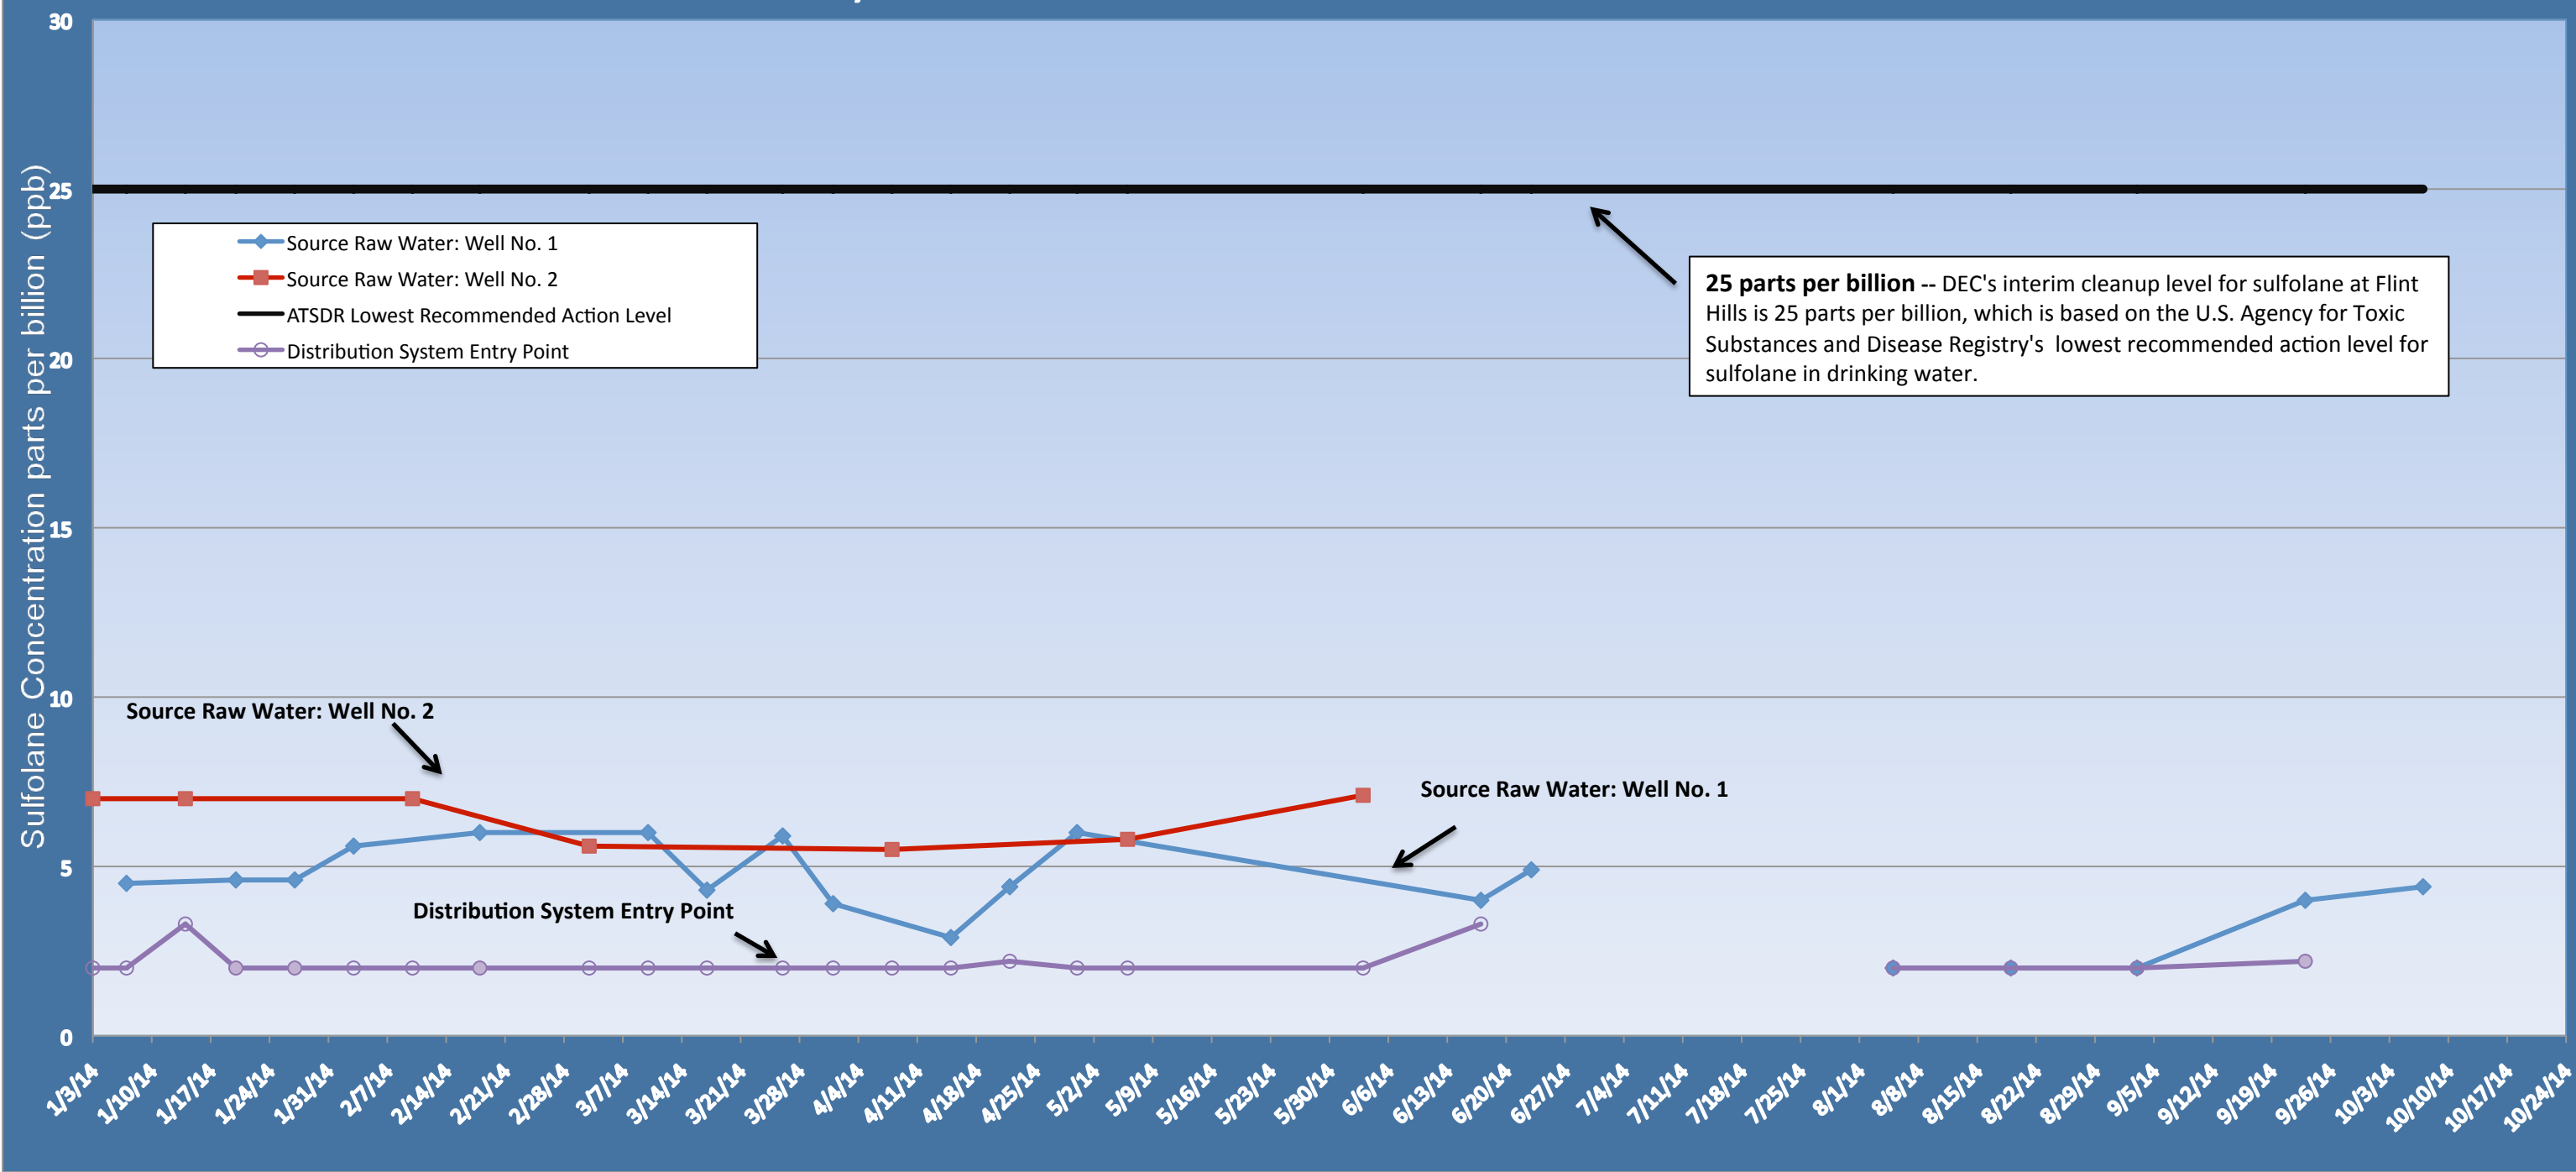

	1/2/10	1/6/10	1/13/10	1/19/10	1/26/10	2/2/10	2/9/10	2/17/10	3/2/10	3/9/10	3/16/10	3/25/10	3/31/10	4/7/10	4/14/10	4/21/10	4/29/10	5/5/10	6/2/10	6/16/10	6/22/10	8/4/10	8/18/10	9/2/10	9/22/10	10/6/10
—Source Raw Water: Well No. 1	NS	4.5	NS	4.6	4.6	5.6	NS	6	NS	6	4.3	5.9	3.9	NS	2.9	4.4	6	NS	NS	4	4.9	ND	ND	ND	4	4.4
—Source Raw Water: Well No. 2	7	NS	7	NS	NS	NS	7	NS	5.6	NS	NS	NS	NS	5.5	NS	NS	NS	5.8	7.1	NS	NS	NS	NS	NS	NS	NS
—Distribution System Entry Point	ND	ND	3.3	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	2.2	ND	ND	ND	3.3	NA	ND	ND	ND	2.4	3.6

Distribution System Entry Point means treated water going to consumers.

NS means Not Sampled.

ND means Not Detected at a detection limit of approximately 2.0 parts per billion and is indicated by an open marker. The closed marker indicates a detection.

NA means Not Available the data was rejected because the sample exceeded laboratory hold time.

Data is not available for late June and July 2010 because lab instrumentation was down.

Traditionally, Well No. 1 has been used in the winter and Well No. 2 in the summer, mainly to keep Well No. 2 active. But the City of North Pole has opted to continue using Well No. 1 this summer because the sulfolane levels for Well No. 2 have been slightly higher.